



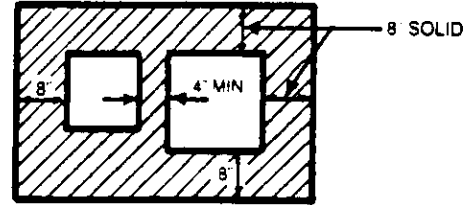


MASONRY CHIMNEYS

TOP OF CHIMNEY MUST BE AT LEAST 2 FEET HIGHER THAN PEAK OR HIGHEST PORTION OF ROOF WITHIN 10 FEET HORIZONTALLY

MINIMUM HEIGHT ABOVE ROOF WHERE CHIMNEY PENETRATES VARIES. SEE U.B.C. TABLE 31-B.

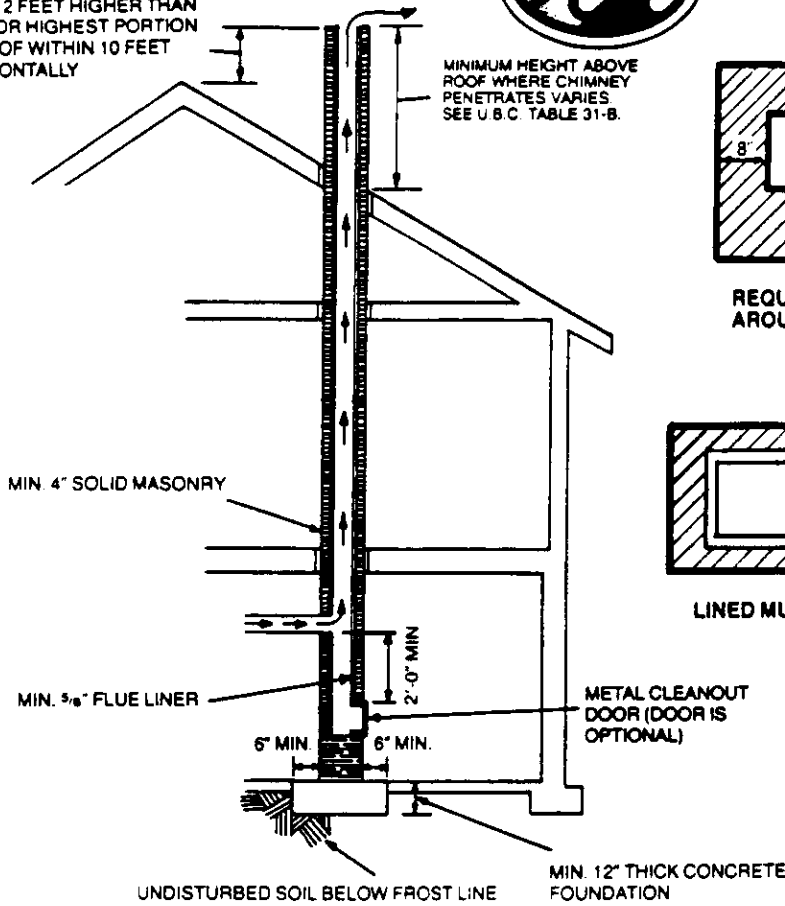


REQUIRED PROTECTION AROUND UNLINED FLUES

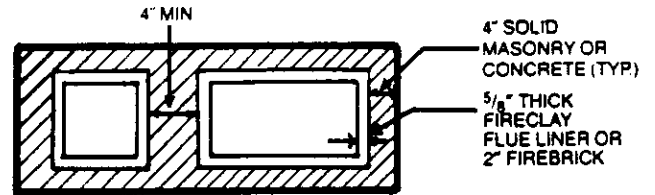

LINED MULTIPLE-FLUE CHIMNEY

TYPICAL MASONRY CHIMNEY

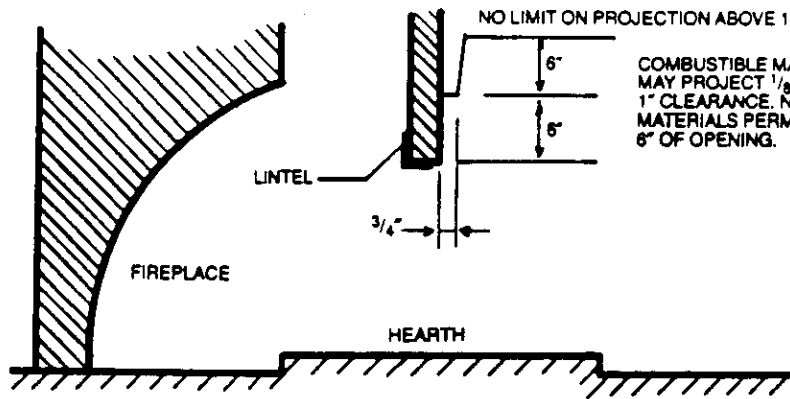

COMBUSTIBLE MATERIALS PROJECTION FROM FIREPLACE